

Performance analysis of four bed adsorption water desalination/refrigeration system, comparison of AQSOA-ZO2 to silica gel

Al-Dadah, Raya; Mahmoud, Saad; Youssef, Peter

DOI:

[10.1016/j.desal.2015.08.002](https://doi.org/10.1016/j.desal.2015.08.002)

License:

Creative Commons: Attribution-NonCommercial-NoDerivs (CC BY-NC-ND)

Document Version

Peer reviewed version

Citation for published version (Harvard):

Al-Dadah, R, Mahmoud, S & Youssef, P 2015, 'Performance analysis of four bed adsorption water desalination/refrigeration system, comparison of AQSOA-ZO2 to silica gel', *Desalination*, vol. 375, pp. 100-107. <https://doi.org/10.1016/j.desal.2015.08.002>

[Link to publication on Research at Birmingham portal](#)

Publisher Rights Statement:

After an embargo period this document is available under the terms of a Creative Commons Attribution Non-Commercial No Derivatives license.

Checked August 2015

General rights

Unless a licence is specified above, all rights (including copyright and moral rights) in this document are retained by the authors and/or the copyright holders. The express permission of the copyright holder must be obtained for any use of this material other than for purposes permitted by law.

- Users may freely distribute the URL that is used to identify this publication.
- Users may download and/or print one copy of the publication from the University of Birmingham research portal for the purpose of private study or non-commercial research.
- User may use extracts from the document in line with the concept of 'fair dealing' under the Copyright, Designs and Patents Act 1988 (?)
- Users may not further distribute the material nor use it for the purposes of commercial gain.

Where a licence is displayed above, please note the terms and conditions of the licence govern your use of this document.

When citing, please reference the published version.

Take down policy

While the University of Birmingham exercises care and attention in making items available there are rare occasions when an item has been uploaded in error or has been deemed to be commercially or otherwise sensitive.

If you believe that this is the case for this document, please contact UBIRA@lists.bham.ac.uk providing details and we will remove access to the work immediately and investigate.

Performance Analysis of Four Bed Adsorption Water Desalination / Refrigeration System, Comparison of AQSOA-Z02 to Silica-gel

Peter G. Youssef*, Saad M. Mahmoud, Raya K. AL-Dadah

Abstract—Although many water desalination techniques have been introduced decades ago, there are still areas around the world suffering from fresh water shortages. The widespread of desalination technologies is limited due to their high energy consumption, cost and adverse environmental impact. Recently, adsorption technology for water desalination has been investigated showing potential of using low temperature waste heat (50-85°C) thus reducing energy consumption and CO₂ emissions. This work mathematically investigates the performance of 4 bed adsorption cycle using two different adsorbents, *silica-gel* and an advanced zeolite material *AQSOA-Z02*, produced by Mitsubishi-plastics for fresh water production and cooling. The work studied effects of evaporator and heat source temperatures on water production rate and cooling capacity. Results showed that at low chilled water temperatures below 20°C, *AQSOA-Z02* outperform *silica-gel* with water production of 6.2 m³ of water/day and cooling of 53.7 Rton/ tonne of *AQSOA-Z02* compared to 3.5 m³ of water/day and 15.0 Rton/tonne of *silica-gel*. While, at chilled water temperatures above 20°C, *AQSOA-Z02* and *silica-gel* have comparable performance with around 7m³ of water/day and 60 Rton of cooling. Since cooling applications require chilled water temperature less than 20°C, therefore *AQSOA-Z02* is more suitable for applications where cooling and fresh water are needed.

Keywords—Adsorption, AQSOA-Z02, Desalination, Refrigeration, Seawater, Silica-gel.

1. INTRODUCTION

Although about 70% of the earth is covered with water, 97% of this water is salty. Also, only 0.3% of the remaining 3% is usable by humans since the remaining fresh water is either underground or in the form of ice covering mountainous regions [1]. Therefore seawater

desalination is required to provide part of human needs for water. Different desalination technologies exist like thermal, membrane and chemical [2] but many of these suffer from excessive energy consumption; adverse environmental impact and high cost [3, 4]. Recently, adsorption technology was shown to provide water desalination with minimum energy consumption [5]. It is capable of producing fresh water with low salinity of 10 ppm, running cost of 0.2\$/m³ and CO₂ emissions of 0.6 kg/m³ [6]. In this technology, besides water production, cooling can be produced for air conditioning required in many areas around the world [7-11]. A major advantage of adsorption technology is its ability to utilize low grade waste heat sources (50 - 85°C) or solar energy and using environmentally friendly refrigerants leading to lower pollution and cost [8, 12]. A comparison between a lumped parameter model and experimental tests has been presented by Ng et al [13]. The comparison covered wide range of operating conditions for basic and hybrid *silica-gel*/water pair adsorption cycles that are able to produce cooling and desalination. In addition the energetic efficiency and life cycle cost (LCC) of adsorption plants have been compared to other conventional desalination technologies. It was found that adsorption desalination plants require electrical energy of 1.38 kWh/m³ and thermal energy of 38.8 kWh/m³. Comparing to other desalination methods, multi effect desalination (MED) and multi stage flash (MSF) needs 43.21 and 57.14 kWh/m³ of thermal energy respectively. Also reverse osmosis (RO) needs 3.5-5 kWh/m³ of electric energy. Moreover, studies showed that adsorption desalination and cooling cycle has the lowest cost of US \$2.7/ MWh compared to

*P. G. Youssef is a PhD student at University of Birmingham, UK (phone: +44-0121-4143513; fax: +44-0121-4143598; e-mail: pgy348@bham.ac.uk).

Nomenclature

c	Uptake (kg.kg ⁻¹)	PR	Performance ratio (-)
c^*	Equilibrium uptake (kg. kg ⁻¹)	Q_{st}	Isosteric heat of adsorption (kJ/kg)
c_p	Specific heat at constant pressure (kg. kg ⁻¹ .K ⁻¹)	SCP	Specific cooling power (kW.kg ⁻¹)
COP	Coefficient of performance (-)	$SDWP$	Specific daily water production (m ³ t ⁻¹ day ⁻¹)
h	Enthalpy (kJ.kg ⁻¹)	T	Temperature (K)
M	Mass (kg)	X	Salt concentration (ppm)
m	Mass flow rate (kg.s ⁻¹)	θ	Seawater charging flag (-)
n	Adsorption/Desorption phase, flag (-)	γ	Brine discharge flag (-)
OCR	Overall conversion ratio (-)	τ	No of cycles per day (-)
P	Pressure (kPa)		

Subscripts

a	Adsorbent material	hw	Heating Water
ads	Adsorption	HX	Heat exchanger
b	Brine	in	inlet
$cond$	Condenser	$Mads$	Master adsorber bed
cw	Cooling Water	$Mdes$	Master desorber bed
D	vapor	out	outlet
d	Distillate water	s	Seawater
des	Desorption	$Sads$	Slave adsorber bed
$evap$	Evaporator	$Sdes$	Slave desorber bed
f	Liquid	t	Time

\$4.4/MWh for the combined RO and mechanical chiller or \$3.4/MWh for RO and absorption chiller.

The desalination/refrigeration adsorption system consists of four consecutive processes namely evaporation, adsorption, desorption and condensation. In the evaporator, seawater is evaporated due to the effect of adsorption by the dry adsorbent material while extracting heat from the chilled water passing through the evaporator coil thus producing cooling effect [14]. In the adsorption process, water vapour is adsorbed by the adsorbent material while in the desorption process the water vapour is regenerated by the waste heat. The desorbed water vapour is then condensed in the condenser producing fresh water [8, 15].

Various researchers have investigated the use of adsorption technology for water desalination and cooling using silica gel with various cycle configurations. Wang et al. [12], experimentally investigated the performance of a four bed *silica-*

gel adsorption desalination system, studying the effects of cycle time, hot, cold and chilled water temperatures on water production rates and cycle coefficient of performance. They found that at chilled water temperature of 12.2°C, a maximum specific daily water production (SDWP) of 4.7 m³/day per tonne of silica gel was obtained using cycle time of 150 seconds, switching time of 40 seconds and low heat source temperature of 85°C. In addition, they have reported that this method of desalination produced potable water without any means of bio-contamination.

Thu et al. [16] studied experimentally the performance of a four bed silica gel adsorption desalination system that operates on either two or four bed configuration. In the two bed operation, each two beds are heated or cooled jointly while in the four bed operation mode, each two beds are heated or cooled sequentially in a master and slave arrangement. Water production and performance ratio were studied at different heat source temperatures with constant heat sink temperature using cycle time ranging from 950 to 2400 seconds for two bed operation or from 480

1 to 1920 seconds for four bed operation.
2 Experimental results showed that in four bed
3 operation at low heat source temperature ($<65^{\circ}\text{C}$),
4 a longer cycle time (1560 sec.) is required for the
5 production of maximum amount of fresh water of
6 6.28 m^3 of water per day per tonne of silica gel.
7 At the maximum heat source temperature of
8 85°C , the two bed configuration produced 8.79
9 m^3/day per tonne of silica gel while the four bed
10 master-slave configuration produced 10 m^3 of
11 water per day per tonne of silica gel with
12 performance ratio of 0.61.

13 Mitra et al. [17], have analyzed a four bed
14 single stage silica gel/water adsorption
15 desalination system that used solar energy for the
16 desorption process. Effects of condenser
17 temperature and cycle time were studied to find
18 the optimum operating conditions for maximum
19 water production and cooling outputs. Simulation
20 results showed that 600-900 seconds is the
21 optimum half cycle time for producing maximum
22 SDWP and specific cooling power (SCP) of
23 $2.3\text{m}^3/\text{day}$ and 18 Rton per tonne of silica gel
24 respectively at condenser temperature of 25°C .
25 They concluded that compromise is needed
26 between desalination and cooling capacities as
27 COP increases with increasing in cycle time
28 while increasing condenser temperature degrades
29 the cycle performance.

30 Ng et al. [8], have developed a mathematical
31 model for a 4 bed adsorption system using silica
32 gel/water pair to produce both cooling and
33 desalinated fresh water. At different hot and
34 chilled water temperatures, cycle performance
35 was analyzed by calculating SCP, SDWP, and
36 overall conversion ratio (OCR). It was found that
37 a silica gel adsorption cycle can produce $8\text{ m}^3/\text{day}$
38 and 51.6 Rton per tonne of silica gel when
39 optimized for water production at evaporator
40 temperature of 30°C or $3.8\text{ m}^3/\text{day}$ and 22 Rton
41 per tonne of silica gel at evaporator temperature
42 of 10°C . In addition, the cycle can reach a
43 maximum OCR of 1.4.

44 Ng et al. [10], have investigated
45 experimentally and mathematically a 4 bed
46 adsorption cycle that uses *silica-gel/water* pair.
47 The cycle is capable of producing two useful

48 effects which are desalination and cooling using
49 solar energy at low temperature namely (65 to
50 80°C). Measurements indicated that chilled water
51 at 7 to 10°C with a SCP of 25-35 Rton/tonne of
52 silica gel can be produced in addition to a SDWP
53 of $3\text{-}5\text{ m}^3$ per tonne of silica gel per day while the
54 OCR ranging from 0.8-1.1.

55 Youssef et al. [18], compared numerically the
56 performance of an adsorption, two bed cycle
57 using *AQSOA-Z02/water* with the same two bed
58 cycle using *Silica-gel/water*. Different heating
59 source temperatures and evaporator water inlet
60 temperatures were applied to study their effect on
61 cycle performance. It was found that at all heating
62 temperatures, and evaporator water inlet
63 temperatures above 25°C , *Silica-gel* cycle
64 produces more water and cooling. *Silica-gel* cycle
65 produces maximum SDWP of 8.4 m^3 and 62.4
66 Rton of cooling at 30°C evaporator water inlet
67 temperature. However, as evaporator inlet water
68 temperature decreases, *AQSOA-Z02* outperforms
69 *Silica-gel*. At 10°C evaporator inlet water
70 temperature, *AQSOA-Z02* cycle produced 5.8 m^3
71 of fresh water per day and 50.1 Rton of cooling
72 while *Silica-gel* cycle generated only SDWP of
73 2.8 m^3 and SCP of 17.2 Rton .

74 *AQSOA-Z02* was studied as an adsorbent but
75 in other applications like cooling [19] and
76 dehumidification [20]. Verdi et al. [19] have
77 developed a numerical model for a truck air
78 conditioning system using *AQSOA-Z02/ water*
79 adsorption system that utilizes waste heat from
80 truck engine at temperature ($80\text{-}90^{\circ}\text{C}$).
81 Experimental tests were also performed using a
82 lab-based adsorption chiller prototype. The
83 specific cooling power produced at the laboratory
84 reached 600 W/kg of *AQSOA-Z02* which is
85 180% higher than the amount of cooling
86 produced by *Silica-gel* system which is 334 W/kg
87 [21].

88 Intini et al. [20] have analyzed numerically
89 and experimentally the performance of an
90 *AQSOA*-based desiccant wheel. Performance of
91 the system was assessed by determining the effect
92 of area ratio, process inlet temperature, humidity
93 and air force velocity. It was found that maximum
94 moisture removal capacity is achieved at equal

1 area split. In addition, inlet humidity ratio was
 2 found to be important in determining moisture
 3 removal efficiency while process inlet
 4 temperature is not that much effective.

5
 6 All reviewed work on water adsorption
 7 desalination, showed that *silica-gel* / water was
 8 the only adsorption working pair investigated in a
 9 4 bed cycle. This work, investigates the use of an
 10 advanced zeolite adsorbent material, (*AQSOA*
 11 *FAM-ZO2*, produced by Mitsubishi plastics) in a 4
 12 beds adsorption cycle for production of both
 13 cooling and fresh water. The effect of operating
 14 conditions in terms of evaporator and hot water
 15 temperatures were studied and compared to those
 16 for a silica gel 4 beds adsorption desalination
 17 system.

19 2. SYSTEM MODELLING

20 A full scale four bed adsorption machine is
 21 simulated by Simulink to study its ability to
 22 produce both cooling and fresh water. It
 23 comprises of four beds with the capacity of 890
 24 kg of silica gel per bed in addition to an
 25 evaporator and a condenser (Fig. 1).

32 hot water is passed through desorbing beds
 33 (master then slave bed). Fresh water is obtained
 34 from the condenser by condensing water vapour
 35 via external cooling water passing through
 36 cooling coil while cooling is achieved at the
 37 evaporator.

39 In order to study the cycle, energy equations are
 40 solved for evaporator, condenser, adsorber and
 41 desorber beds in addition to mass and salt balance
 42 equations for the evaporator [8] as shown in
 43 equations 1-6:

45 *Evaporator mass balance equation:*

$$46 \frac{dM_{s,evap}}{dt} = \theta m_{s,in} - \gamma m_b - \frac{dc_{Mads}}{dt} M_a$$

$$47 - n \cdot \frac{dc_{sads}}{dt} M_a \quad (1)$$

49 *Evaporator salt balance equation:*

$$50 M_{s,evap} \frac{dX_{s,evap}}{dt} = \theta X_{s,in} m_{s,in} - \gamma X_{s,evap} m_{brine}$$

$$51 - X_D \frac{dc_{Mads}}{dt} M_a - n \cdot X_D \frac{dc_{sads}}{dt} M_a \quad (2)$$

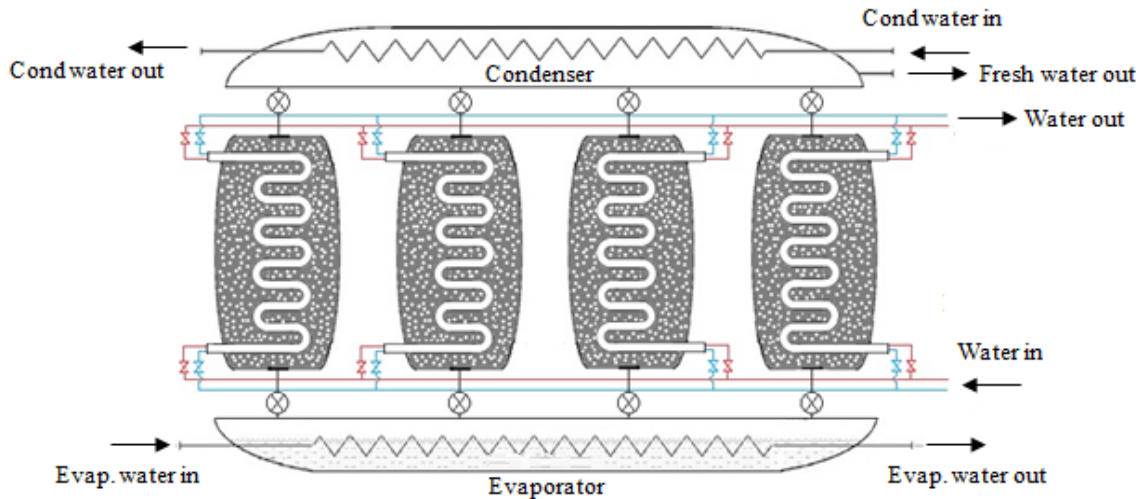


Fig. 1 Schematic diagram of the adsorption system

26
 27 In this system, cooling water is passed through
 28 first adsorbing bed (master bed) and the outlet
 29 stream continues the cooling process in the
 30 second adsorber bed (slave bed). This cooling is
 31 to absorb the heat of adsorption. For desorption,

54
 55 *Evaporator energy balance equation:*

$$57 [M_{s,evap} c_{p,s}(T_{evap}, X_{s,evap}) + M_{HX,Evap} c_{p,HX}] \frac{dT_{evap}}{dt} =$$

$$\begin{aligned}
& \theta \cdot h_f(T_{evap}, X_{s,evap}) m_{s,in} - h_{fg}(T_{evap}) \frac{dc_{Mads}}{dt} M_a \\
& - n \cdot h_{fg}(T_{evap}) \frac{dc_{Sads}}{dt} M_a - \gamma h_f(T_{evap}, X_{s,evap}) m_b \\
& + m_{chilled} c_p(T_{evap})(T_{chilled,in} - T_{chilled,out})
\end{aligned} \quad (3)$$

Master adsorption /desorption bed, energy balance equation:

$$\begin{aligned}
& [M_a c_{p,a} + M_{HX} c_{p,HX} + M_{abe} c_{p,abe}] \frac{dT_{Mads/Mdes}}{dt} = \\
& \pm m_{cw/hw} c_p (T_{cw/hw,in} - T_{cw/hw,out}) \\
& \pm Q_{st} M_a \frac{dc_{Mads/Mdes}}{dt}
\end{aligned} \quad (4)$$

Slave adsorption /desorption bed, energy balance equation:

$$\begin{aligned}
& [M_a c_{p,a} + M_{HX} c_{p,HX} + M_{abe} c_{p,abe}] \frac{dT_{Sads/Sdes}}{dt} = \\
& \pm m_{cw/hw} c_p (T_{cw/hw,in} - T_{cw/hw,out}) \\
& \pm z \cdot Q_{st} M_a \frac{dc_{ads/des}}{dt}
\end{aligned} \quad (5)$$

Where, z is a flag equals 0 in heat recovery phase and 1 in all other cases.

Condenser energy balance equation:

$$\begin{aligned}
& [M_{cond} c_p(T_{cond}) + M_{HX,Cond} c_{p,HX}] \frac{dT_{cond}}{dt} = \\
& h_f \frac{dM_d}{dt} + h_{fg}(T_{cond}) M_a \left(\frac{dc_{Mdes}}{dt} + n \cdot \frac{dc_{Sdes}}{dt} \right) \\
& + m_{cond} c_p(T_{cond})(T_{cond,in} - T_{cond,out})
\end{aligned} \quad (6)$$

For assessment of cycle performance, different parameters are calculated which are specific daily water production (SDWP), performance ratio (PR) which is the ratio between heat of condensation to the heat of desorption, specific cooling power (SCP) and coefficient of performance (COP). For the determination of the overall cycle performance where two useful effects are obtained from the same heat source, overall conversion ratio (OCR) is calculated. OCR is the ratio between useful effects produced (summation of heat of condensation and heat of evaporation) over the input which is heat of

desorption [8]. These parameters are calculated using equations 7-14:

$$SDWP = \int_0^{t_{cycle}} \frac{Q_{cond}}{h_{fg} M_a} dt \quad (7)$$

$$PR = \frac{1}{t_{cycle}} \int_0^{t_{cycle}} \frac{m_d h_{fg}}{Q_{Mdes} + Q_{Sdes}} dt \quad (8)$$

$$SCP = \int_0^{t_{cycle}} \frac{Q_{evap}}{M_a} dt \quad (9)$$

$$COP = \int_0^{t_{cycle}} \frac{Q_{evap}}{Q_{Mdes} + Q_{Sdes}} dt \quad (10)$$

$$OCR = \int_0^{t_{cycle}} \frac{Q_{evap} + Q_{cond}}{Q_{Mdes} + Q_{Sdes}} dt \quad (11)$$

Where,

$$Q_{cond} = m_{cond} c_p(T_{cond})(T_{cond,out} - T_{cond,in}) \quad (12)$$

$$Q_{Mdes/Sdes} = m_{hw} c_p(T_{hw,in} - T_{hw,out}) \quad (13)$$

$$Q_{evap} = m_{chilled} c_p(T_{evap})(T_{chilled,in} - T_{chilled,out}) \quad (14)$$

These set of energy and mass balance equations are solved by Simulink with tolerance value of 1×10^{-6} . A lumped simulation model was used where the adsorbent, adsorbate and heat exchangers are assumed to be momentarily at the same temperature. Also perfect heat insulation is assumed for all parts.

3. ADSORBENT MATERIAL CHARACTERISTICS

Two materials are compared in this work, *Silica-gel*-RD and *AQSOA-ZO2*. Figure 2 (a –b), shows SEM images for both materials and their physical properties are listed in table I [19, 22, 23].

To investigate the performance of any adsorbent material, adsorption isotherms and adsorption kinetics are required.

Adsorption isotherms represent the maximum amount of adsorbate that can be adsorbed per unit mass of dry material at a specific vapor pressure.

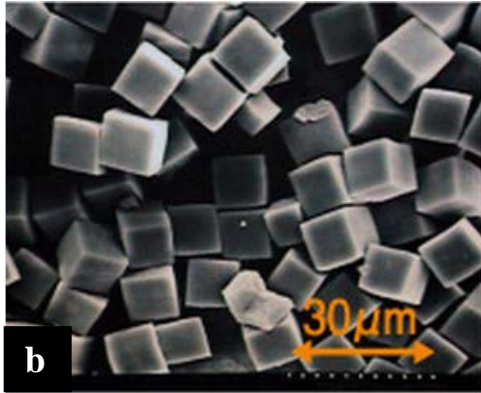
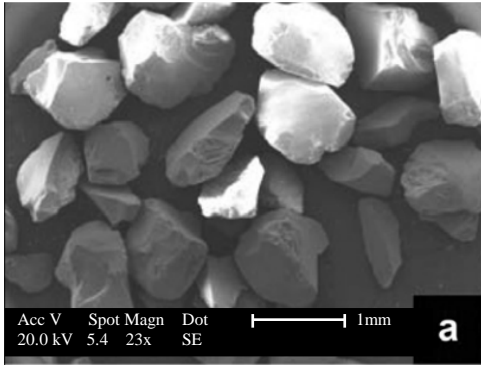


Fig. 2 SEM images for (a) RD Silica-gel
(b) AQSOA-Z02

TABLE I
PHYSICAL PROPERTIES OF ADSORBENT MATERIALS

Property	SILICA GEL	AQSOA-Z02
Granules size	0.18-1 mm	0.25-0.4 mm
BET surface area	840 m ² /g	650-770 m ² /g
Bulk Density	1 g/cm ³	0.5-0.7 g/cm ³

Different isotherm models can predict adsorbent materials performance such as Dubinin-Astakhov (D-A), Sips, Toth, Freundlich, Modified Freundlich and Langmuir. Isotherms of Silica-gel-RD, can be predicted by the Dubinin-Astakhov (D-A) model (equation 15) with the constants given in table II [8].

$$c^* = c_0 \exp \left[- \left(\frac{RT}{E} \ln \left(\frac{P}{P_0} \right) \right)^n \right] \quad (15)$$

TABLE II
DUBININ-ASTAKHOV EQUATION CONSTANTS

Symbol	Value	Unit ^a
c_0	0.592	kg/kg of adsorbent
E	3.105	kJ/mole
n	1.1	(-)
R	8314	J/mole.K

^aUnits are; kg = kilogram, K = Kelvin.

For AQSOA-Z02, water vapor uptake is calculated via the model developed by Sun et al. [24] as shown in equations (16-17).

$$\frac{c}{c_{max}} = \frac{K(P/P_s)^m}{1+(K-1)(P/P_s)^m} \quad (16)$$

Where,

$$K = \alpha \exp[m(Q_{st} - h_{fg})/RT] \quad (17)$$

$$\alpha = 9 * 10^{-7}, m = 3.18 \text{ and } Q_{st} = 3600 \text{ kJ/kg}$$

Where, c_{max} is maximum uptake, m , is heterogeneity factor, h_{fg} , is the latent heat [kJ/kg], R , is universal gas constant [J/mol.K].

As adsorption process is time dependent, adsorption kinetics are needed to determine the rate of adsorption or desorption at the specified operating conditions. Adsorption kinetics are modeled by Linear Driving Force (LDF) model for both materials, (equations 18-19) [8] with all constants given in table III.

$$\frac{dc}{dt} = k(c^* - c) \quad (18)$$

$$k = (15 D_{so}/R_p^2) e^{\left(\frac{-Ea}{RT}\right)} \quad (19)$$

For Silica-gel, LDF model constants are obtained from Ng et al [8] while for AQSOA-Z02, tests by a dynamic vapor sorption (DVS) gravimetric analyzer, fig. 3, were carried out at University of Birmingham to determine the constants.

This DVS analyser consists of a temperature controlled chamber that contains a sensitive recording microbalance (Cahn D200).

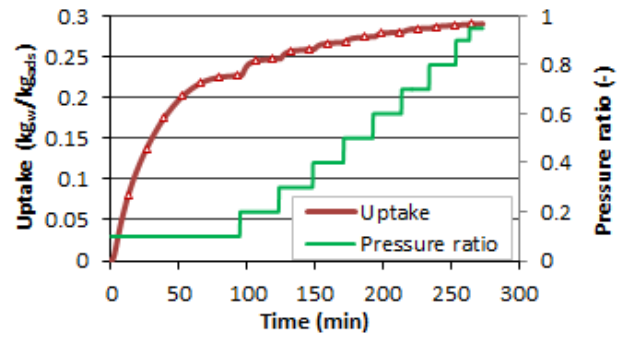
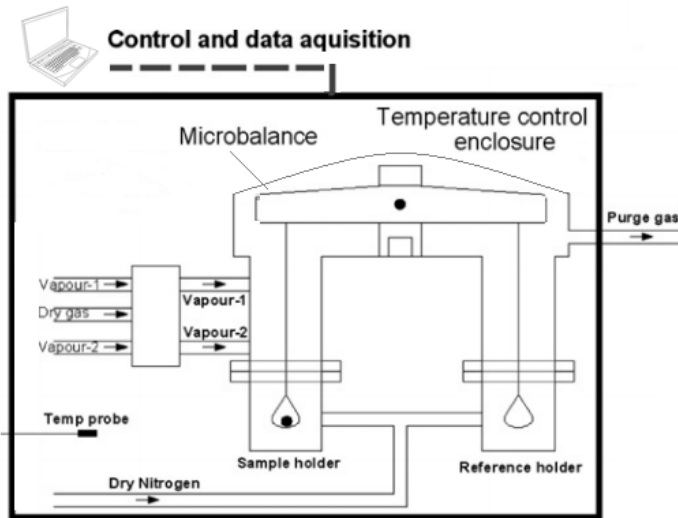


Fig. 4 DVS test results at 36°C for AQSOA-Z02

TABLE III
LINEAR DRIVING FORCE, LDF EQUATION CONSTANTS

Symbol	SILICA	AQSOA-Z02		Unit ^a
	GEL	Pr ^b >0.1	Pr <0.1	
D_{so}	2.54 E-4	4.85 E-9	2.77 E-5	m ² /s
R_p	0.4 E-3	0.15 E-3	0.15 E-3	m
E_a	42000	17709.8	44423.5	J/mol

^aUnits are; m = meter, s = second, J = Joule, mol = mole.

^bPr is the pressure ratio between bed and heat exchanger

Figure 5, compares the LDF predicted temporal uptake to the experimental ones showing deviation of less than ±15%.

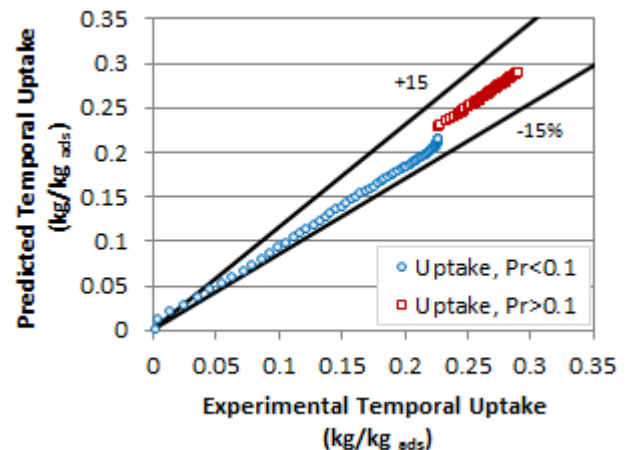


Fig. 5 Comparison between the measured water uptake for AQSOA-Z02 and those predicted by the LDF model

Fig. 3 Schematic diagram of the used DVS instrument

A dry Nitrogen purge system is applied before sample loading to ensure accurate uptake measurements by preventing vapor condensation on the balance head. The vapor pressure in the chamber is regulated by mass flow controller which determines the amount of dry and saturated vapor gas. A PC microcomputer is connected to the microbalance to record mass readings every 4 seconds while vapor pressure sensor and RTD temperature sensor are used to measure testing conditions. The accuracy of the DVS analyser microbalance Cahn is verified by using 100 mg standard calibration mass, where the expected mass accuracy of the tested sample is ±0.05 mg.

To measure adsorption kinetics, firstly a sample of 10 mg (±0.05 mg) is placed in the sample pan and then dried at certain temperature until no change in the mass is recorded. Secondly, adsorption process is started at various partial pressures starting from 0.1-0.95. During that time, change of the mass is calculated every 4 seconds. This test is repeated at different temperatures starting from 20°C to 52°C.

Test results at temperature of 36°C and at different vapor partial pressures (0.1 to 0.95) are shown in Fig. 4. The kinetics of AQSOA-Z02 were then fitted using equations 18, 19 and the constants are tabulated in table III.

4. METHODOLOGY

The developed numerical model of the 4 bed adsorption system shown in fig 1 is validated against the measured experimental results from a *silica-gel/water* adsorption plant operating in a 4-Bed mode for desalination application and cooling production [25]. Fig.6 shows the comparison between the simulation results and experimental measurements for the basic components of an adsorption desalination cycle.

TABLE IV
ERROR RANGE FOR THE VALIDATION OF ADSORPTION
DESALINATION CYCLE

	Maximum (%)	Minimum (%)
<i>Bed 1</i>	4.05	-8.34
<i>Bed 2</i>	4.6	-8.48
<i>Bed 3</i>	2.79	-9.89
<i>Bed 4</i>	3.67	-3.08
<i>Condenser</i>	5.59	-3.98
<i>Evaporator</i>	4.25	-1.37

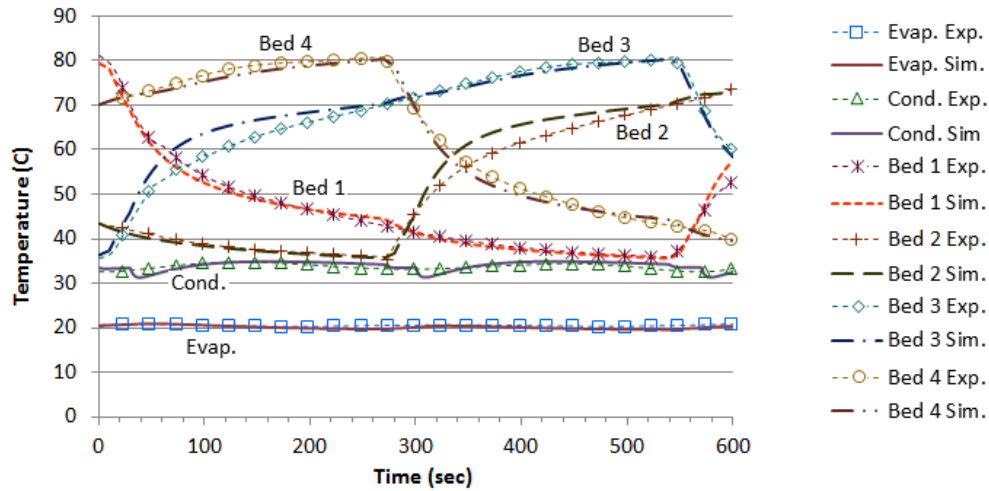


Fig. 6 Comparison of Basic components temperatures for numerical and experimental results for 4-Bed adsorption desalination cycle using silica-gel.

Comparison of cycle outputs i.e. SDWP and SCP are presented in fig.7, where results show that the current model can predict the performance of desalination and cooling cycles within $\pm 10\%$ error margin (table IV).

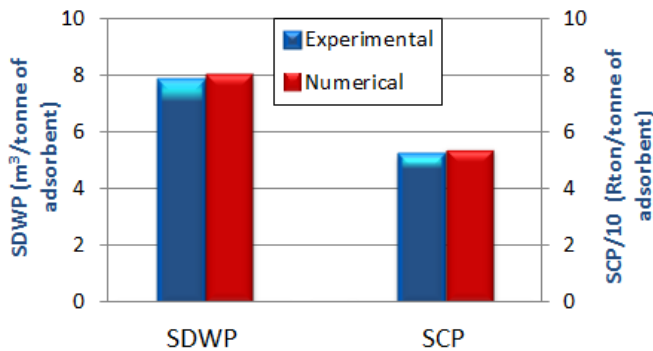


Fig. 7 Comparison of SDWP and SCP for numerical and experimental results for 4-Bed adsorption desalination cycle

To investigate the performance of the *AQSOA-Z02*, a parametric study was carried out to compare the SDWP and SCP of *AQSOA-Z02* against *Silica-gel* at different inlet hot water temperatures and evaporator water temperatures ranging from (65-85°C) and (10-30°C) respectively.

Bed cooling water and condenser cooling water temperatures are kept constant at 30°C with quarter cycle time of 150 sec and switching time of 30 sec.

5. RESULTS AND DISCUSSION

Figures 8 to 13 present SDWP and SCP for different evaporator and hot water temperatures. As shown in Figs 8 to 11, at low hot water temperatures, less than 75°C, *silica-gel* is better than *AQSOA-Z02* at high evaporator temperatures

of more than 20°C. At evaporator water temperature of 30°C, and at hot water temperatures of 65°C, *silica-gel* can result in a SDWP and SCP of 5.4 m³ per day and 38.1 Rton per tonne of *silica-gel*, respectively while *AQSOA-ZO2* is capable only of producing 1.1 m³ per day of fresh water and 6.2 Rton of cooling per tonne of *AQSOA-ZO2*. However, as evaporator water temperature decreases below 18 °C and hot water temperature increases above 75°C, *AQSOA-ZO2* outperforms *silica-gel* as shown in fig. 10 to 10. At evaporator water temperature of 10°C, and at hot water temperatures of 85°C, *AQSOA-ZO2* can produce 6.2 m³ per day and 53.7 Rton per tonne of *AQSOA-ZO2* while *silica-gel* is capable only of producing 3.39 m³ per day of fresh water and 15.7 Rton of cooling per tonne of *silica-gel*.

Another parameter which indicates the cycle performance is the overall conversion ratio, Figs 14 - 15. It is clear that OCR for *silica gel* is highly affected by varying chilled water temperature (Fig. 14), while it is not the case for *AQSOA-ZO2* as shown in Fig. 15 which is a result of the “S” shaped isotherm of *AQSOA-ZO2*. Moreover, Figs 15, proves that hot water temperature highly affects the performance of *AQSOA-ZO2* cycle where OCR varies from 0.3 to 0.8 as hot source temperature increases from 65 to 85 °C. However, silica gel cycle performance is only better than *AQSOA-ZO2* at high evaporator water temperature, above 20°C as it reaches 1.1 at 30°C.

According to these results, where heat source temperatures are available at temperatures above 75°C for the applications of space cooling, typically evaporator temperature (10-20°C), *AQSOA-ZO2* is recommended. For applications where evaporator temperature above 20 °C is needed, *silica-gel* becomes more effective.

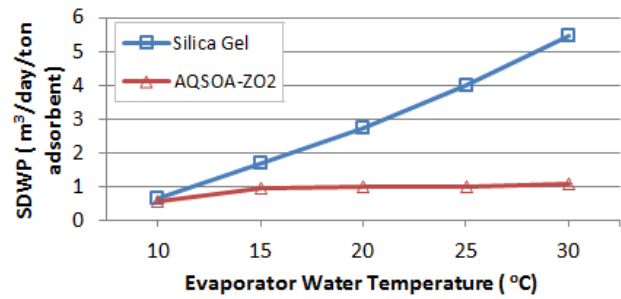


Fig. 8 SDWP at 65°C hot water temperature.

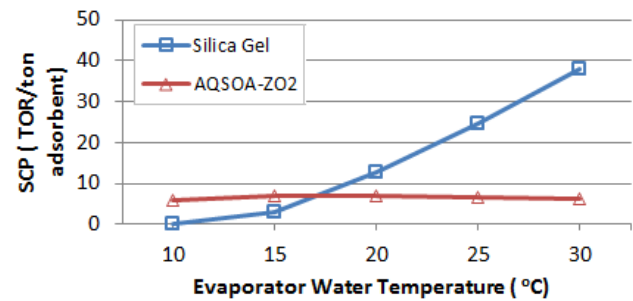


Fig. 9 SCP at 65°C hot water temperature.

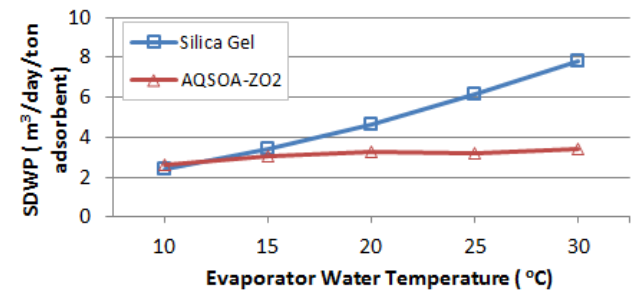


Fig. 10 SDWP at 75°C hot water temperature.

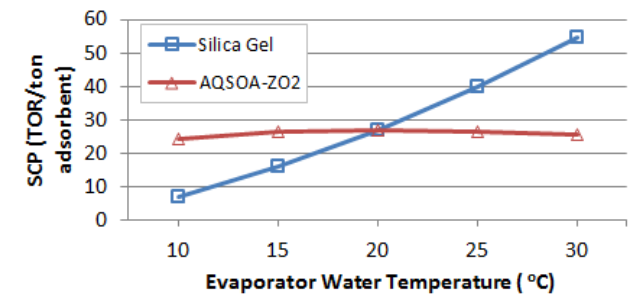


Fig. 11 SCP at 75°C hot water temperature.

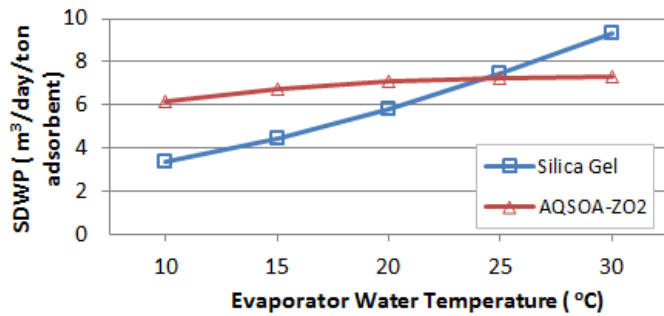


Fig. 12 SDWP at 85°C hot water temperature.

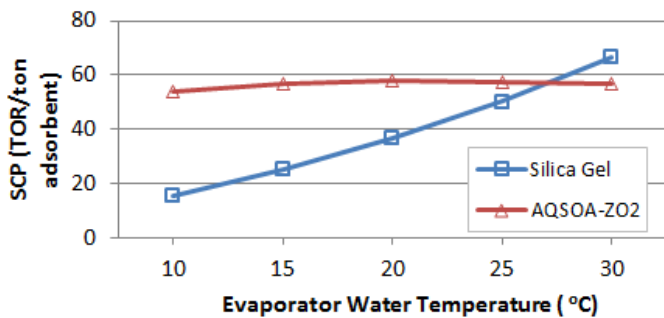


Fig. 13 SCP at 85°C hot water temperature.

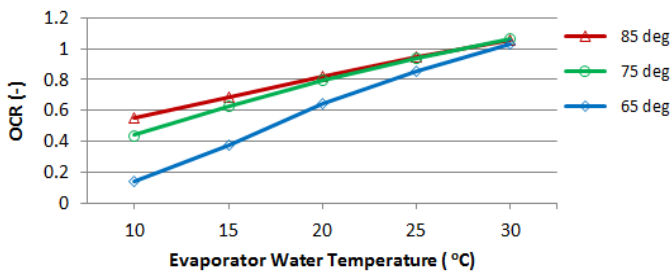


Fig. 14 Overall conversion ratio for *Silica-gel* at hot water temperatures (65-85°C).

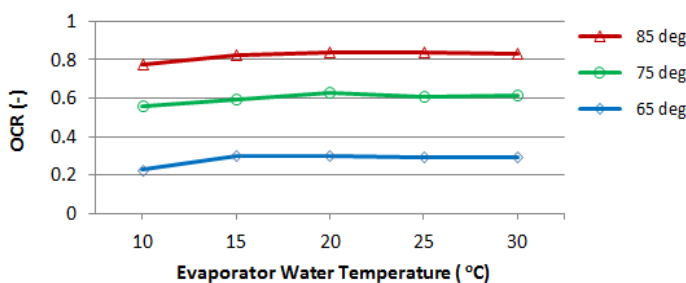


Fig. 15 Overall conversion ratio for *AQSOA-ZO2* at hot water temperatures (65-85°C).

6. CONCLUSIONS

Adsorption based desalination technology outperform other desalination technologies in terms of its ability to use waste heat to produce potable water and simultaneously produce useful cooling effect. However, silica gel adsorbent material was the only material reported in the literature, this work investigates the use of advanced zeolite material *AQSOA-ZO2* in a full scale four bed adsorption system for the purposes of fresh water production and cooling and compared the results to silica gel.

Results showed that for heat source temperatures above 75°C and evaporator temperature below 20°C suitable for cooling applications, *AQSOA-ZO2* outperforms silica gel in terms of higher SDWP and SCP. While for application where evaporator temperature above 20°C is needed, *silica-gel* becomes more effective. Also, such results indicate that the use of combined system of silica gel and zeolites can cover wide range of evaporation temperature to achieve best combination of cooling and water desalination.

7. ACKNOWLEDGEMENT

The authors would like to thank Weatherite Holdings ltd. for sponsoring the project.

REFERENCES

- [1] H. Bigas. Water security & the Global Water Agenda. A UN-Water Analytical Brief: Institute for Water, Environment and Health 2013.
- [2] H. T. El-Dessouky, H. M. Ettouney. Fundamentals of salt water desalination: ELSEVIER; 2002.
- [3] J. Cotruvo, N. Voutchkov, J. Fawell, P. Payment, D. Cunliffe, S. Lattemann. Desalination Technology Health and Environmental Impacts: Taylor and Francis Group; 2010.
- [4] T. Mezher, H. Fath, Z. Abbas, A. Khaled. Techno-economic assessment and environmental impacts of desalination technologies. Desalination. 2011;266:263-73.
- [5] L. K. Wang, J. P. Chen, Y.-T. Hung, N. K. Shamma. Membrane and Desalination Technologies: Springer Science & Business Media; 2010.
- [6] P. G. Youssef, R. K. Al-Dadah, S. M. Mahmoud. Comparative Analysis of Desalination Technologies. Energy Procedia. 2014;61:2604-7.
- [7] J. W. Wu, E. J. Hu, M. J. Biggs. Thermodynamic cycles of adsorption desalination system. Applied Energy. 2012;90:316-22.

- [8] K. C. Ng, K. Thu, B. B. Saha, A. Chakraborty. Study on a waste heat-driven adsorption cooling cum desalination cycle. *International Journal of Refrigeration*. 2012;35:685-93.
- [9] A. Chakraborty, K. Thu, K. C. Ng. Advanced Adsorption Cooling Cum Desalination Cycle- a Thermodynamic Framework. ASME 2011 International Mechanical Engineering Congress & Exposition IMECE2011. Denver, Colorado, USA2011.
- [10] K. C. Ng, K. Thu, A. Chakraborty, B. B. Saha, W. G. Chun. Solar-assisted dual-effect adsorption cycle for the production of cooling effect and potable water. *International Journal of Low-Carbon Technologies*. 2009;4:61-7.
- [11] J. W. Wu, M. J. Biggs, E. J. Hu. Thermodynamic analysis of an adsorption-based desalination cycle. *Chemical Engineering Research and Design*. 2010;88:1541-7.
- [12] X. Wang, K. C. Ng. Experimental investigation of an adsorption desalination plant using low-temperature waste heat. *Applied Thermal Engineering*. 2005;25:2780-9.
- [13] K. C. Ng, K. Thu, Y. Kim, A. Chakraborty, G. Amy. Adsorption desalination: An emerging low-cost thermal desalination method. *Desalination*. 2013;308:161-79.
- [14] T. X. Li, R. Z. Wang, H. Li. Progress in the development of solid-gas sorption refrigeration thermodynamic cycle driven by low-grade thermal energy. *Progress in Energy and Combustion Science*. 2014;40:1-58.
- [15] K. C. Ng, X.-L. Wang, L. Gao, A. Chakraborty, B. B. Saha, S. Koyama, A. Akisawa, T. Kashiwagi. Apparatus and Method for Desalination. 2010.
- [16] K. Thu, K. C. Ng, B. B. Saha, A. Chakraborty, S. Koyama. Operational strategy of adsorption desalination systems. *International Journal of Heat and Mass Transfer*. 2009;52:1811-6.
- [17] S. Mitra, K. Srinivasan, P. Kumar, S. S. Murthy, P. Dutta. Solar Driven Adsorption Desalination System. *Energy Procedia*. 2014;49:2261-9.
- [18] P. G. Youssef, S. M. Mahmoud, R. K. Al-Dadah. Effect of Evaporator Temperature on the Performance of Water Desalination / Refrigeration Adsorption System Using AQSOA-ZO2. *International Journal of Environment, Chemical, Ecological, Geological Engineering*. 2015;9:679-83.
- [19] M. Verde, L. Cortés, J. M. Corberán, A. Sapienza, S. Vasta, G. Restuccia. Modelling of an adsorption system driven by engine waste heat for truck cabin A/C. Performance estimation for a standard driving cycle. *Applied Thermal Engineering*. 2010;30:1511-22.
- [20] M. Intini, M. Goldsworthy, S. White, C. M. Joppolo. Experimental analysis and numerical modelling of an AQSOA zeolite desiccant wheel. *Applied Thermal Engineering*. 2015;80:20-30.
- [21] R. d. Boer, S. F. Smeding, S. Mola. Silicagel-water adsorption cooling prototype system for mobile air conditioning. Heat Powered Cycles Conference. Berlin2009.
- [22] A. Rezk, R. Al-Dadah, S. Mahmoud, A. Elsayed. Characterisation of metal organic frameworks for adsorption cooling. *International Journal of Heat and Mass Transfer*. 2012;55:7366-74.
- [23] MITSUBISHI PLASTICS, Zeolite, AQSOA. https://www.mpi.co.jp/english/products/industrial_materials/im010.html.
- [24] B. Sun, A. Chakraborty. Thermodynamic formalism of water uptakes on solid porous adsorbents for adsorption cooling applications. *Applied Physics Letters*. 2014;104:201901.
- [25] K. Thu. Adsorption desalination Theory and experiment: National University of Singapore; 2010.